



PROFIL PODŁUŻNY SIĘCI WODOCIAGOWEJ Ø125/11,4 PE

dz. nr 1023/2 ul. Szkolna

dz. nr 1024 ul. Brzozowa, pobocze do odtworzenia

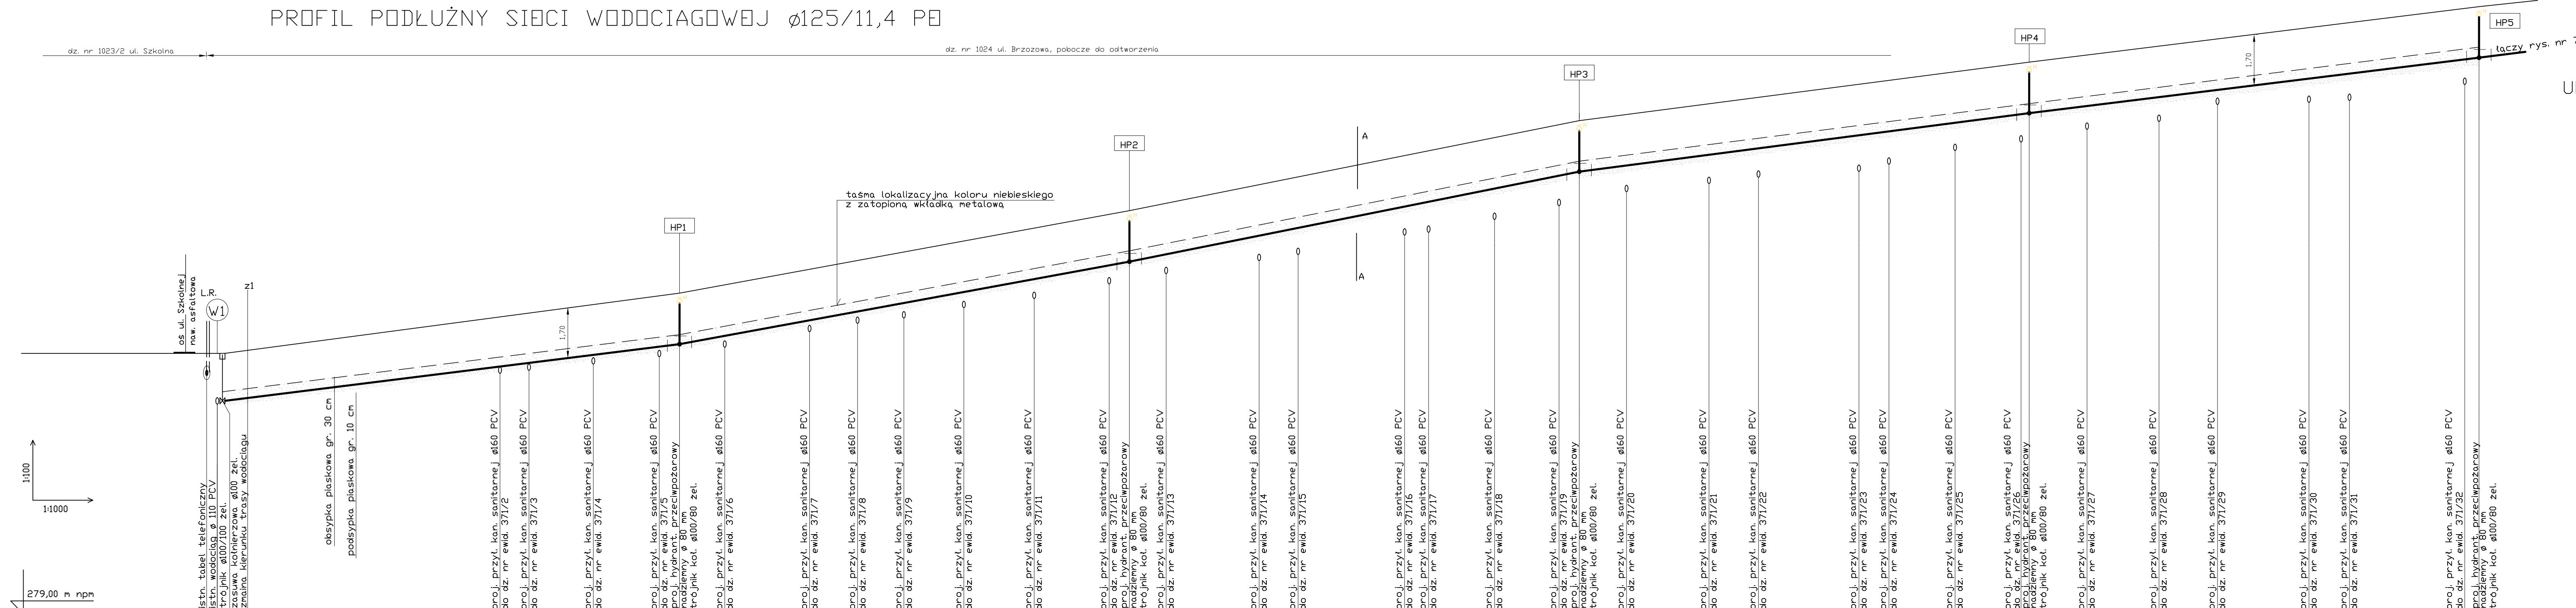

UŁOŻENIE WODOCIAGU I ZASYPIANIE
1:25
PRZĘKRÓJ A-A

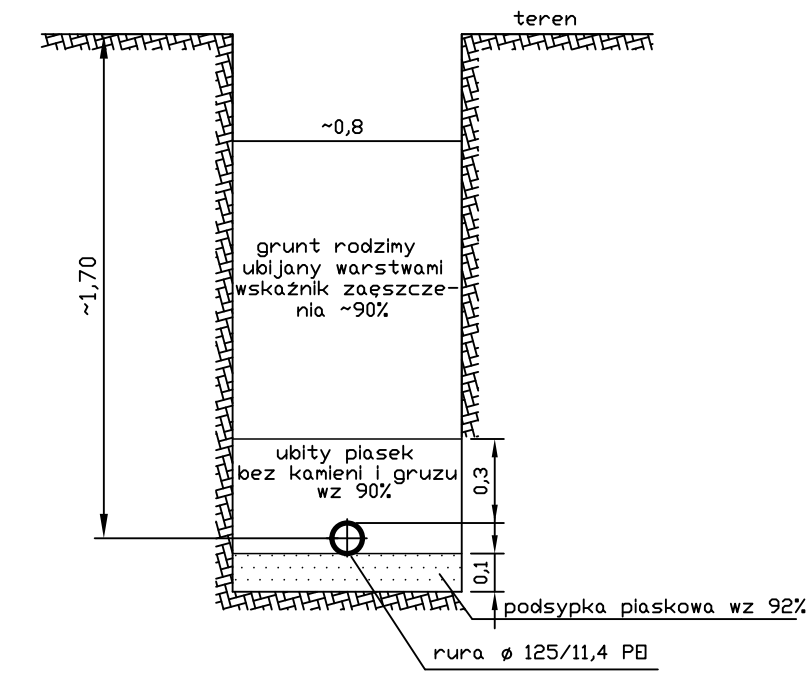

RZĘDNA TORBNU	m n.p.m.	0.00	6.00	90.25	143.25	150.00	165.20	193.25	209.25	224.80	244.80	268.25	293.25	300.00	316.25	343.25	356.25	391.75	399.75	421.75	443.25	450.00	465.75	493.25	509.75	543.25	553.25	575.20	597.20	600.00	619.20	643.20	662.80	693.20	706.80	745.25	
RZĘDNA DNA RURY	m n.p.m.	0.00	6.00	90.25	143.25	150.00	165.20	193.25	209.25	224.80	244.80	268.25	293.25	300.00	316.25	343.25	356.25	391.75	399.75	421.75	443.25	450.00	465.75	493.25	509.75	543.25	553.25	575.20	597.20	600.00	619.20	643.20	662.80	693.20	706.80	745.25	
ZAGŁĘBIENIE RURY	m	1.70	1.70	1.78	1.85	1.85	1.94	2.01	1.70	2.08	2.06	2.12	2.29	2.36	2.46	2.73	2.66	2.75	2.92	1.70	2.55	2.42	1.70	2.67	2.43	2.50	2.72	2.58	2.43	2.49	1.70	2.34	2.25	2.16	2.40	2.36	2.41
SPADEK/DŁUGOŚĆ	‰/m	i=1,8%																																			
MATERIAŁ, ŚREDNICA	-/mm	RURA WODOCIAGOWA PEHD SDR 11 Dn 125/11,4 mm PE100 PN-16																																			
ODLEGŁOŚĆ	m	0.00	6.00	90.25	143.25	150.00	165.20	193.25	209.25	224.80	244.80	268.25	293.25	300.00	316.25	343.25	356.25	391.75	399.75	421.75	443.25	450.00	465.75	493.25	509.75	543.25	553.25	575.20	597.20	600.00	619.20	643.20	662.80	693.20	706.80	745.25	
HEKTOMETRY		0	1	2	3	4	5	6	7																												
WĘZŁY		W1		HP1		HP2		HP3		HP4		HP5																									HP5

L=750,00m